



3 OPSD705.010 CB#4
D1.5 1:15

2 OPSD705.010 CB#3
D1.5 1:15

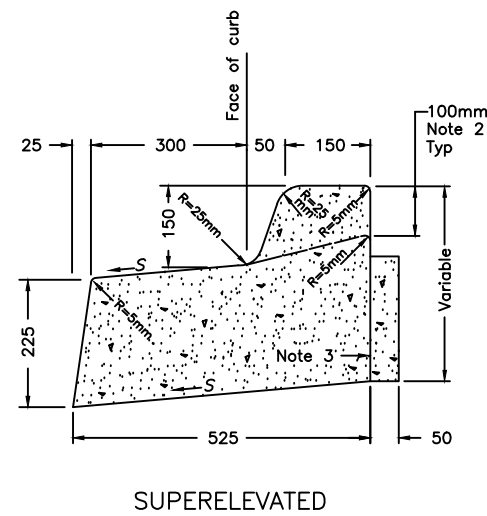

HAMBLY GROUP		WELLINGTON HOTEL	
DIVISION OF 8436550 CANADA CORPORATION		192 Main Street, Wellington, Ontario	
1104 Cedarwoods Dr., Verona, ONTARIO K0H 2W0		SCALE NTS	2021-11-22
TEL 613 374 1748 CEL 613 536 8193 FAX 613 536 9118	SIZE FSCM NO.	DWG NO. D1.5	REV
			SHEET 1

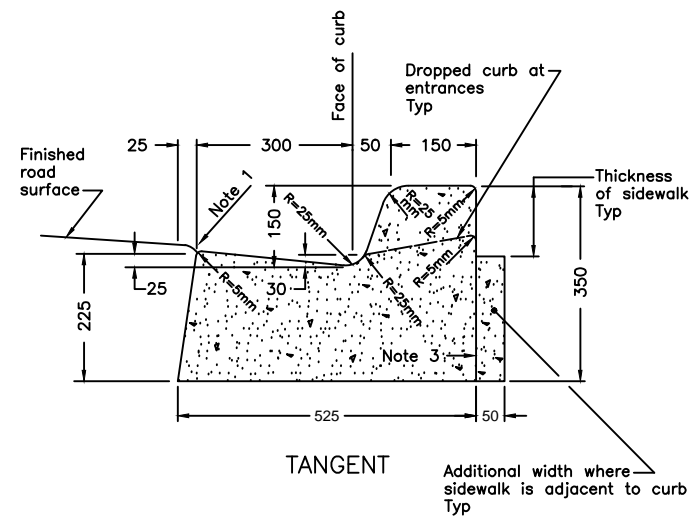



NOTES:

- 1 Flexible pavement shall be 5mm above the adjacent edge of gutter.
- 2 Where sidewalk is continuously adjacent, reduce the dropped curb at entrances to 75mm.
- 3 For slipforming procedure, a 5% batter is acceptable.
- A Treatment at entrances shall conform with OPSD-351.010.
- B Outlet treatment shall conform with OPSD-610 Series.
- C The length of transition from one curb type to another shall be 3.0m, except in conjunction with guide rail, it shall conform to OPSD-900 Series.
- D All dimensions are in millimetres unless otherwise shown.

LEGEND:

S - Rate of pavement superelevation in percent, %.

ONTARIO PROVINCIAL STANDARD DRAWING		April 1999	Rev	
CONCRETE BARRIER CURB WITH STANDARD GUTTER FOR FLEXIBLE PAVEMENT				
		OPSD - 600.040		

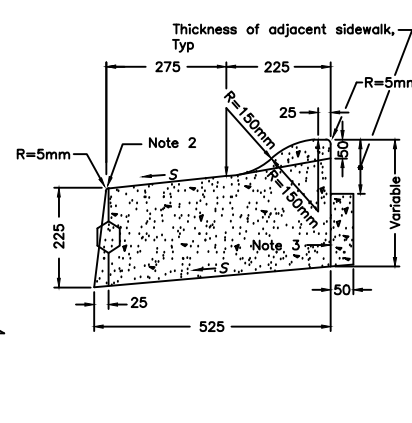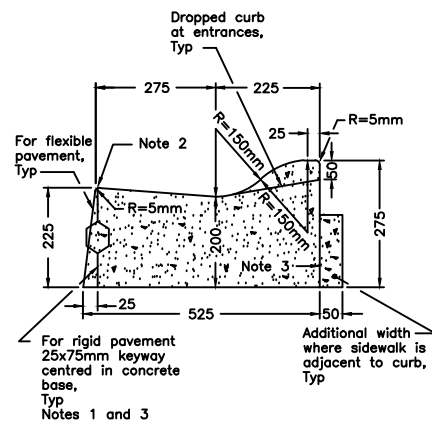


NOTES:

- 1 When curb and gutter is adjacent to concrete pavement or base, this drawing is to be used in conjunction with OPSD-552.010 and 552.020.
- 2 Flexible and composite pavement shall be placed 5mm above the adjacent edge of gutter.
- 3 For slipforming procedure, a 5% batter is acceptable.
- A Treatment at entrances shall conform with OPSD-351.010.
- B Outlet treatment shall conform with OPSD-610 Series.
- C The length of transition from one curb type to another shall be 3.0m, except in conjunction with guide rail, it shall conform to OPSD-900 Series.
- D All dimensions are in millimetres unless otherwise shown.

LEGEND:

S - Rate of pavement superelevation in percent, %.

ONTARIO PROVINCIAL STANDARD DRAWING		April 1999	Rev	
CONCRETE SEMI-MOUNTABLE CURB WITH STANDARD GUTTER				
		OPSD - 600.060		

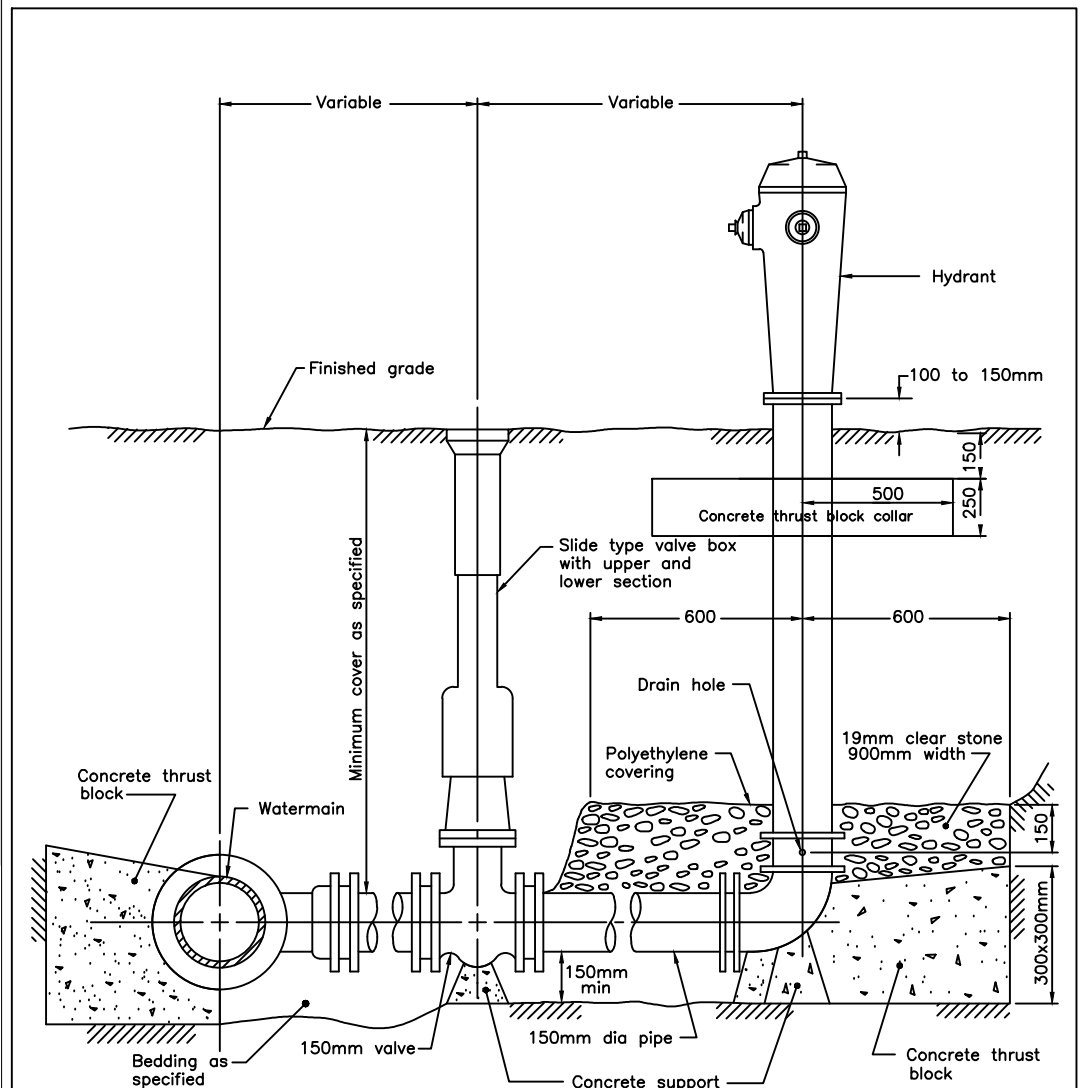





NOTES:

- A All concrete thrust blocks to be poured against undisturbed ground.
- B Bond breaker to be used between the concrete and the fittings and appurtenances.
- C Bolts and nuts for buried flange to flange connections are to be stainless steel.
- D Flange of standpipe extensions not to be in frost zone.
- E All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING		April 1999	Rev	
HYDRANT INSTALLATION				
		OPSD - 1105.010		



HAMBLY GROUP		WELLINGTON HOTEL	
DIVISION OF 8436550 CANADA CORPORATION		SITE PLAN - SITE NOTES	
1104 Cedarwoods Dr., Verona, ONTARIO N0H 2W0		192 Main Street, Wellington, Ontario	
TEL 613 374 1746 CEL 613 536 8193 FAX 613 536 9118	SIZE	FSCM NO.	DWG NO. D1.2
SCALE NTS	2021-11-22	SHEET 1	

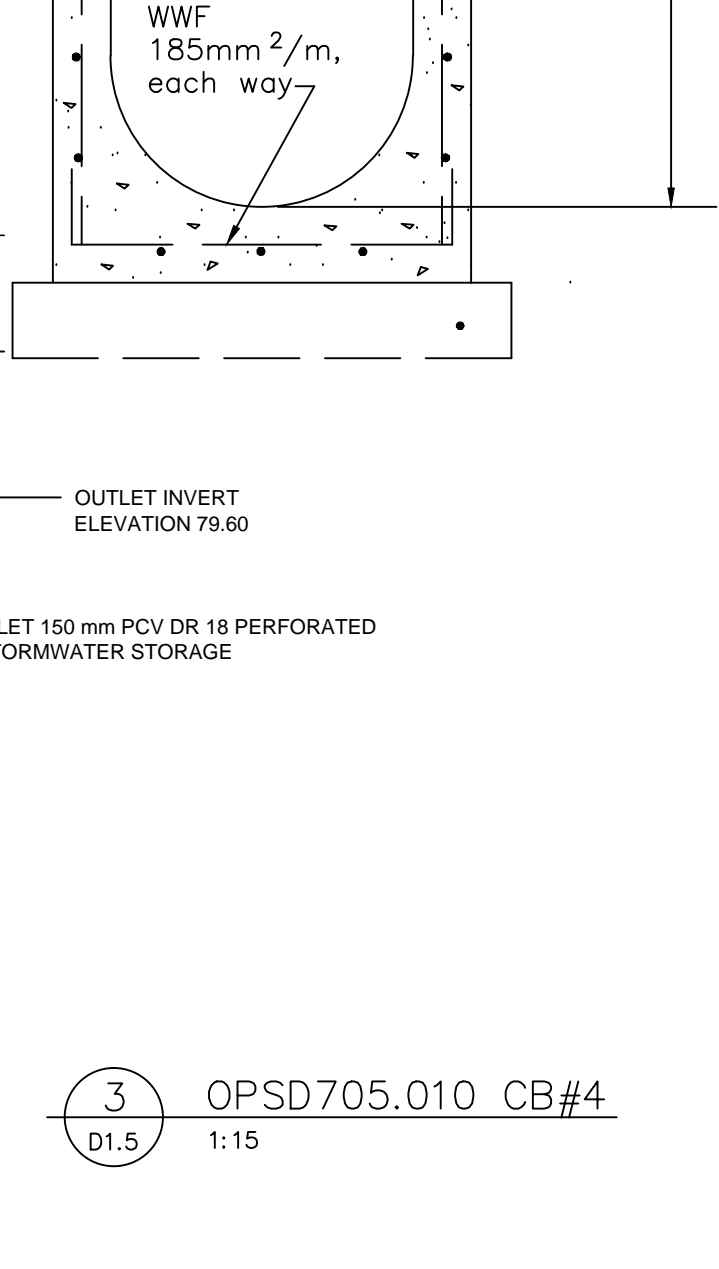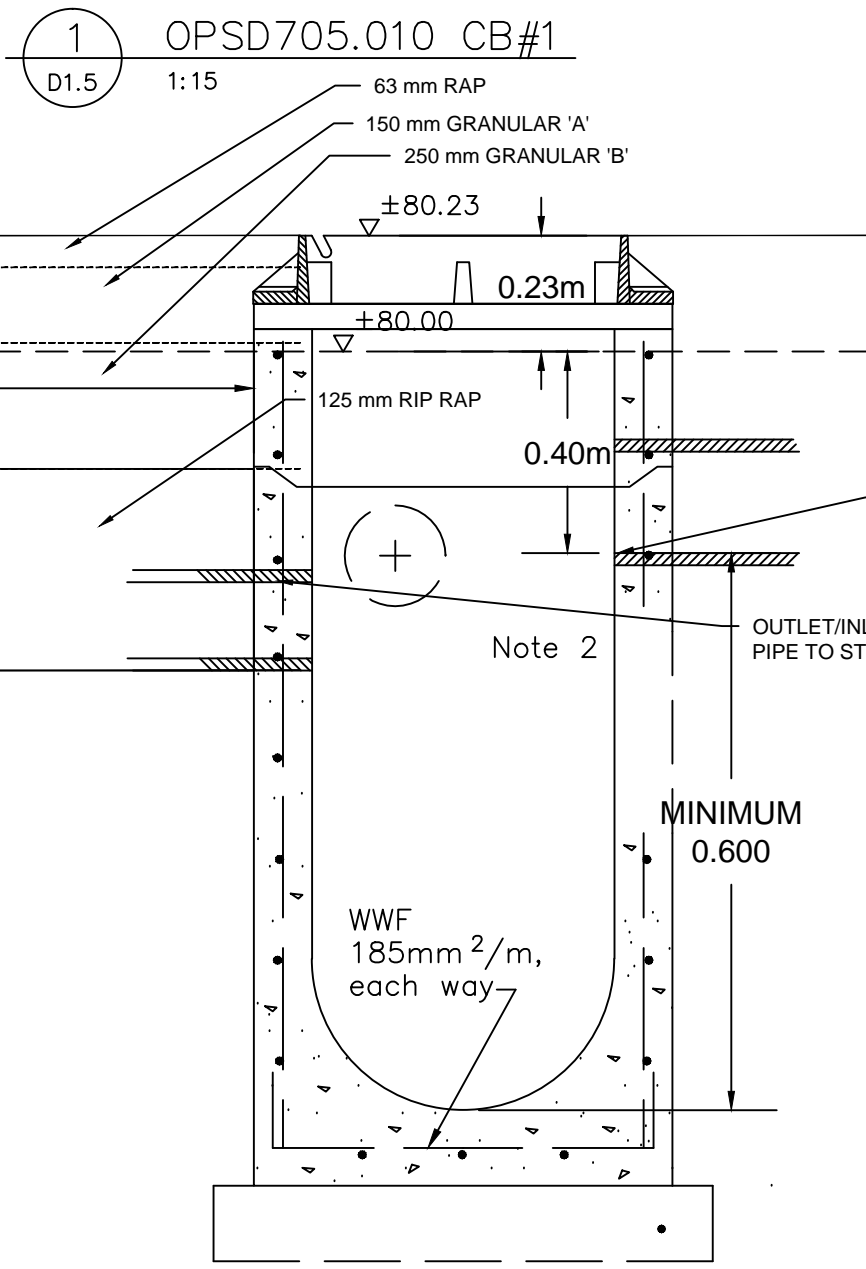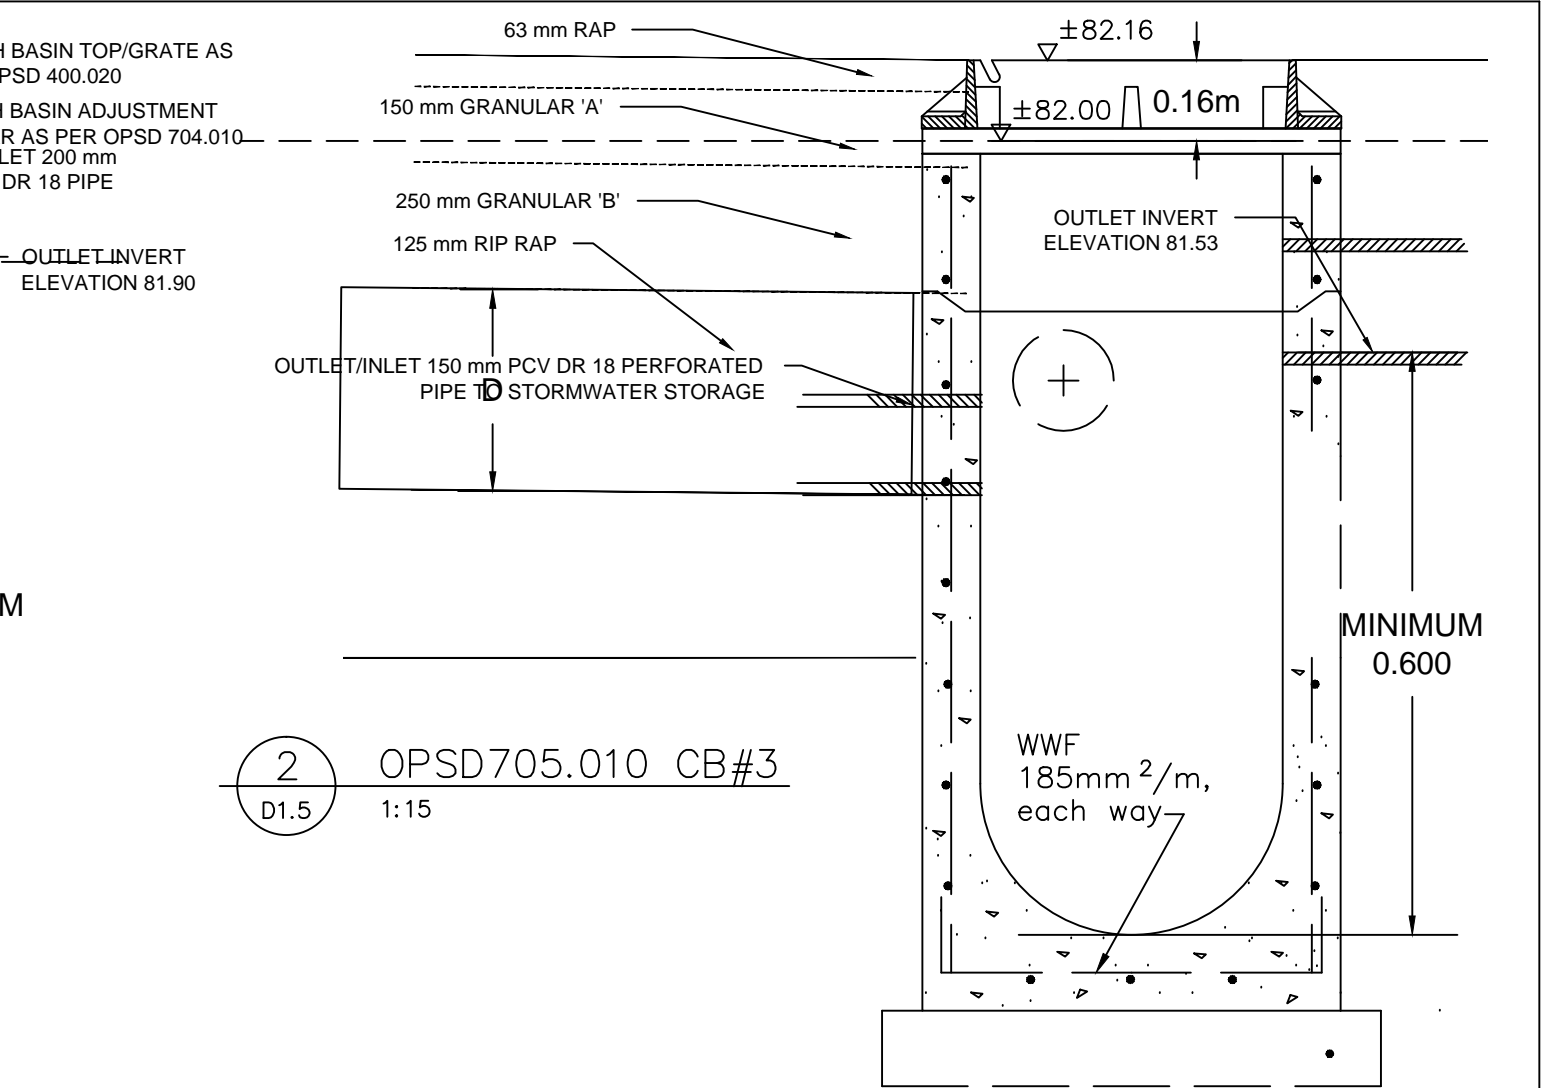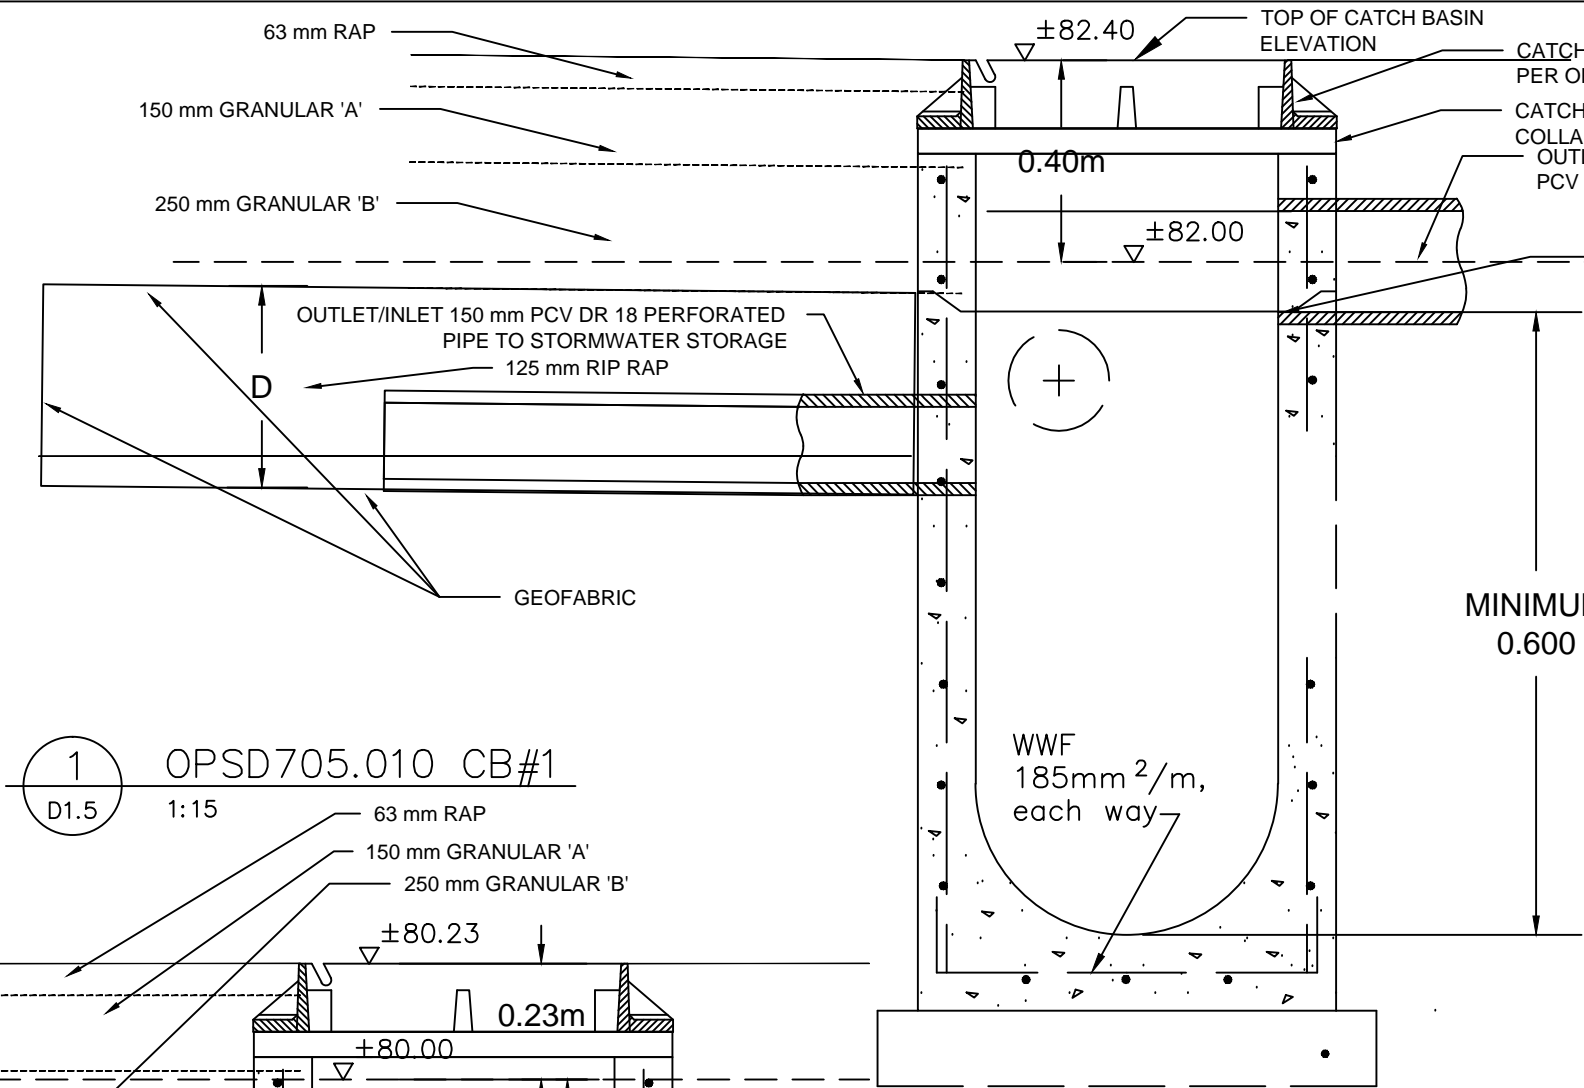

2 OPSD705.010 CB#3
D1.5 1:15

3 OPSD705.010 CB#4
D1.5 1:15



HAMBLY GROUP		WELLINGTON HOTEL	
DIVISION OF 8436550 CANADA CORPORATION		192 Main Street, Wellington, Ontario	
1104 Cedarwoods Dr., Verona, ONTARIO K0H 2W0		SCALE NTS	2021-11-22
TEL 613 374 1746 CEL 613 536 8193 FAX 613 536 9118	SIZE	FSCM NO.	DWG NO. D1.5
			REV
			SHEET 1